
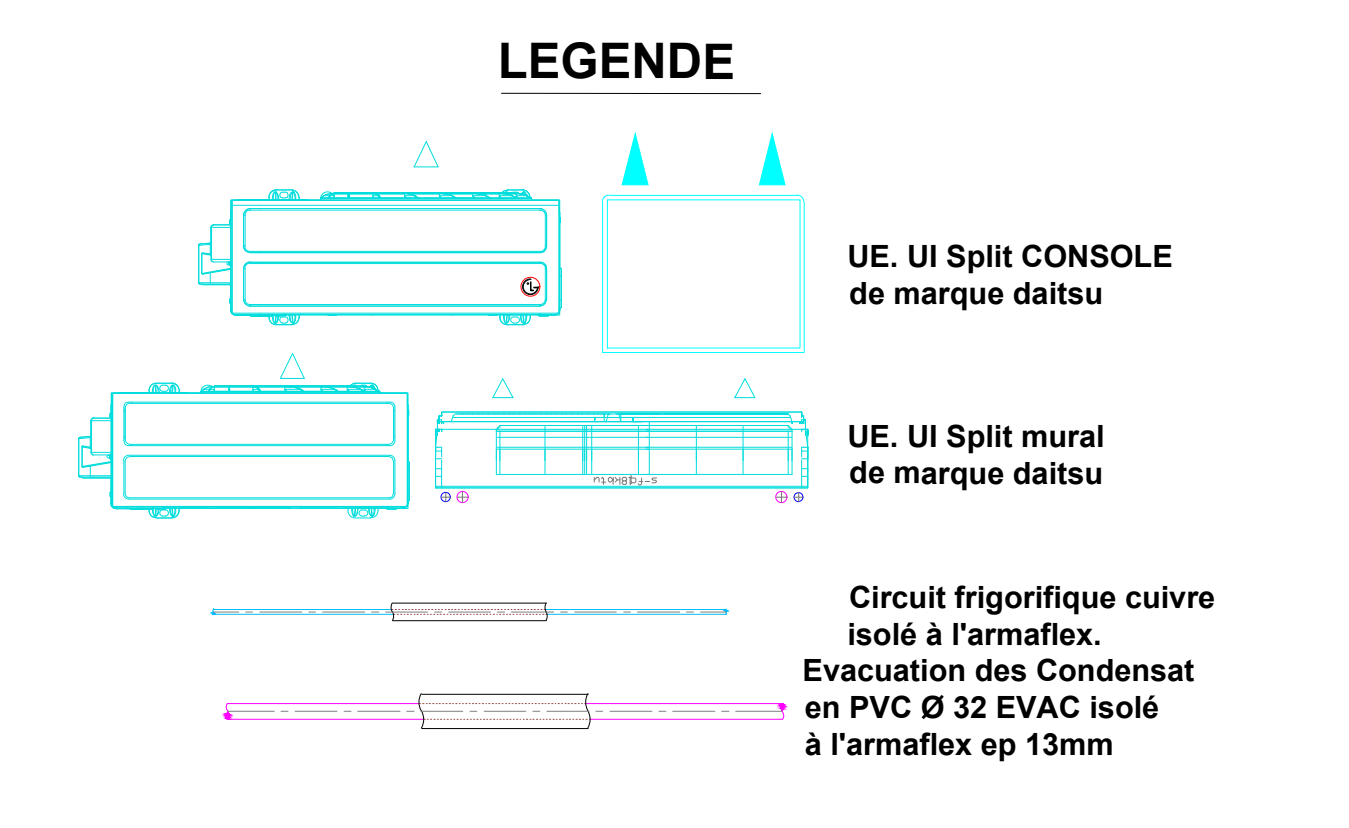


PLAN DE CLIMATISATION ET EVACUATION DES CONDENSATS DE L'ETAGE 01

B3

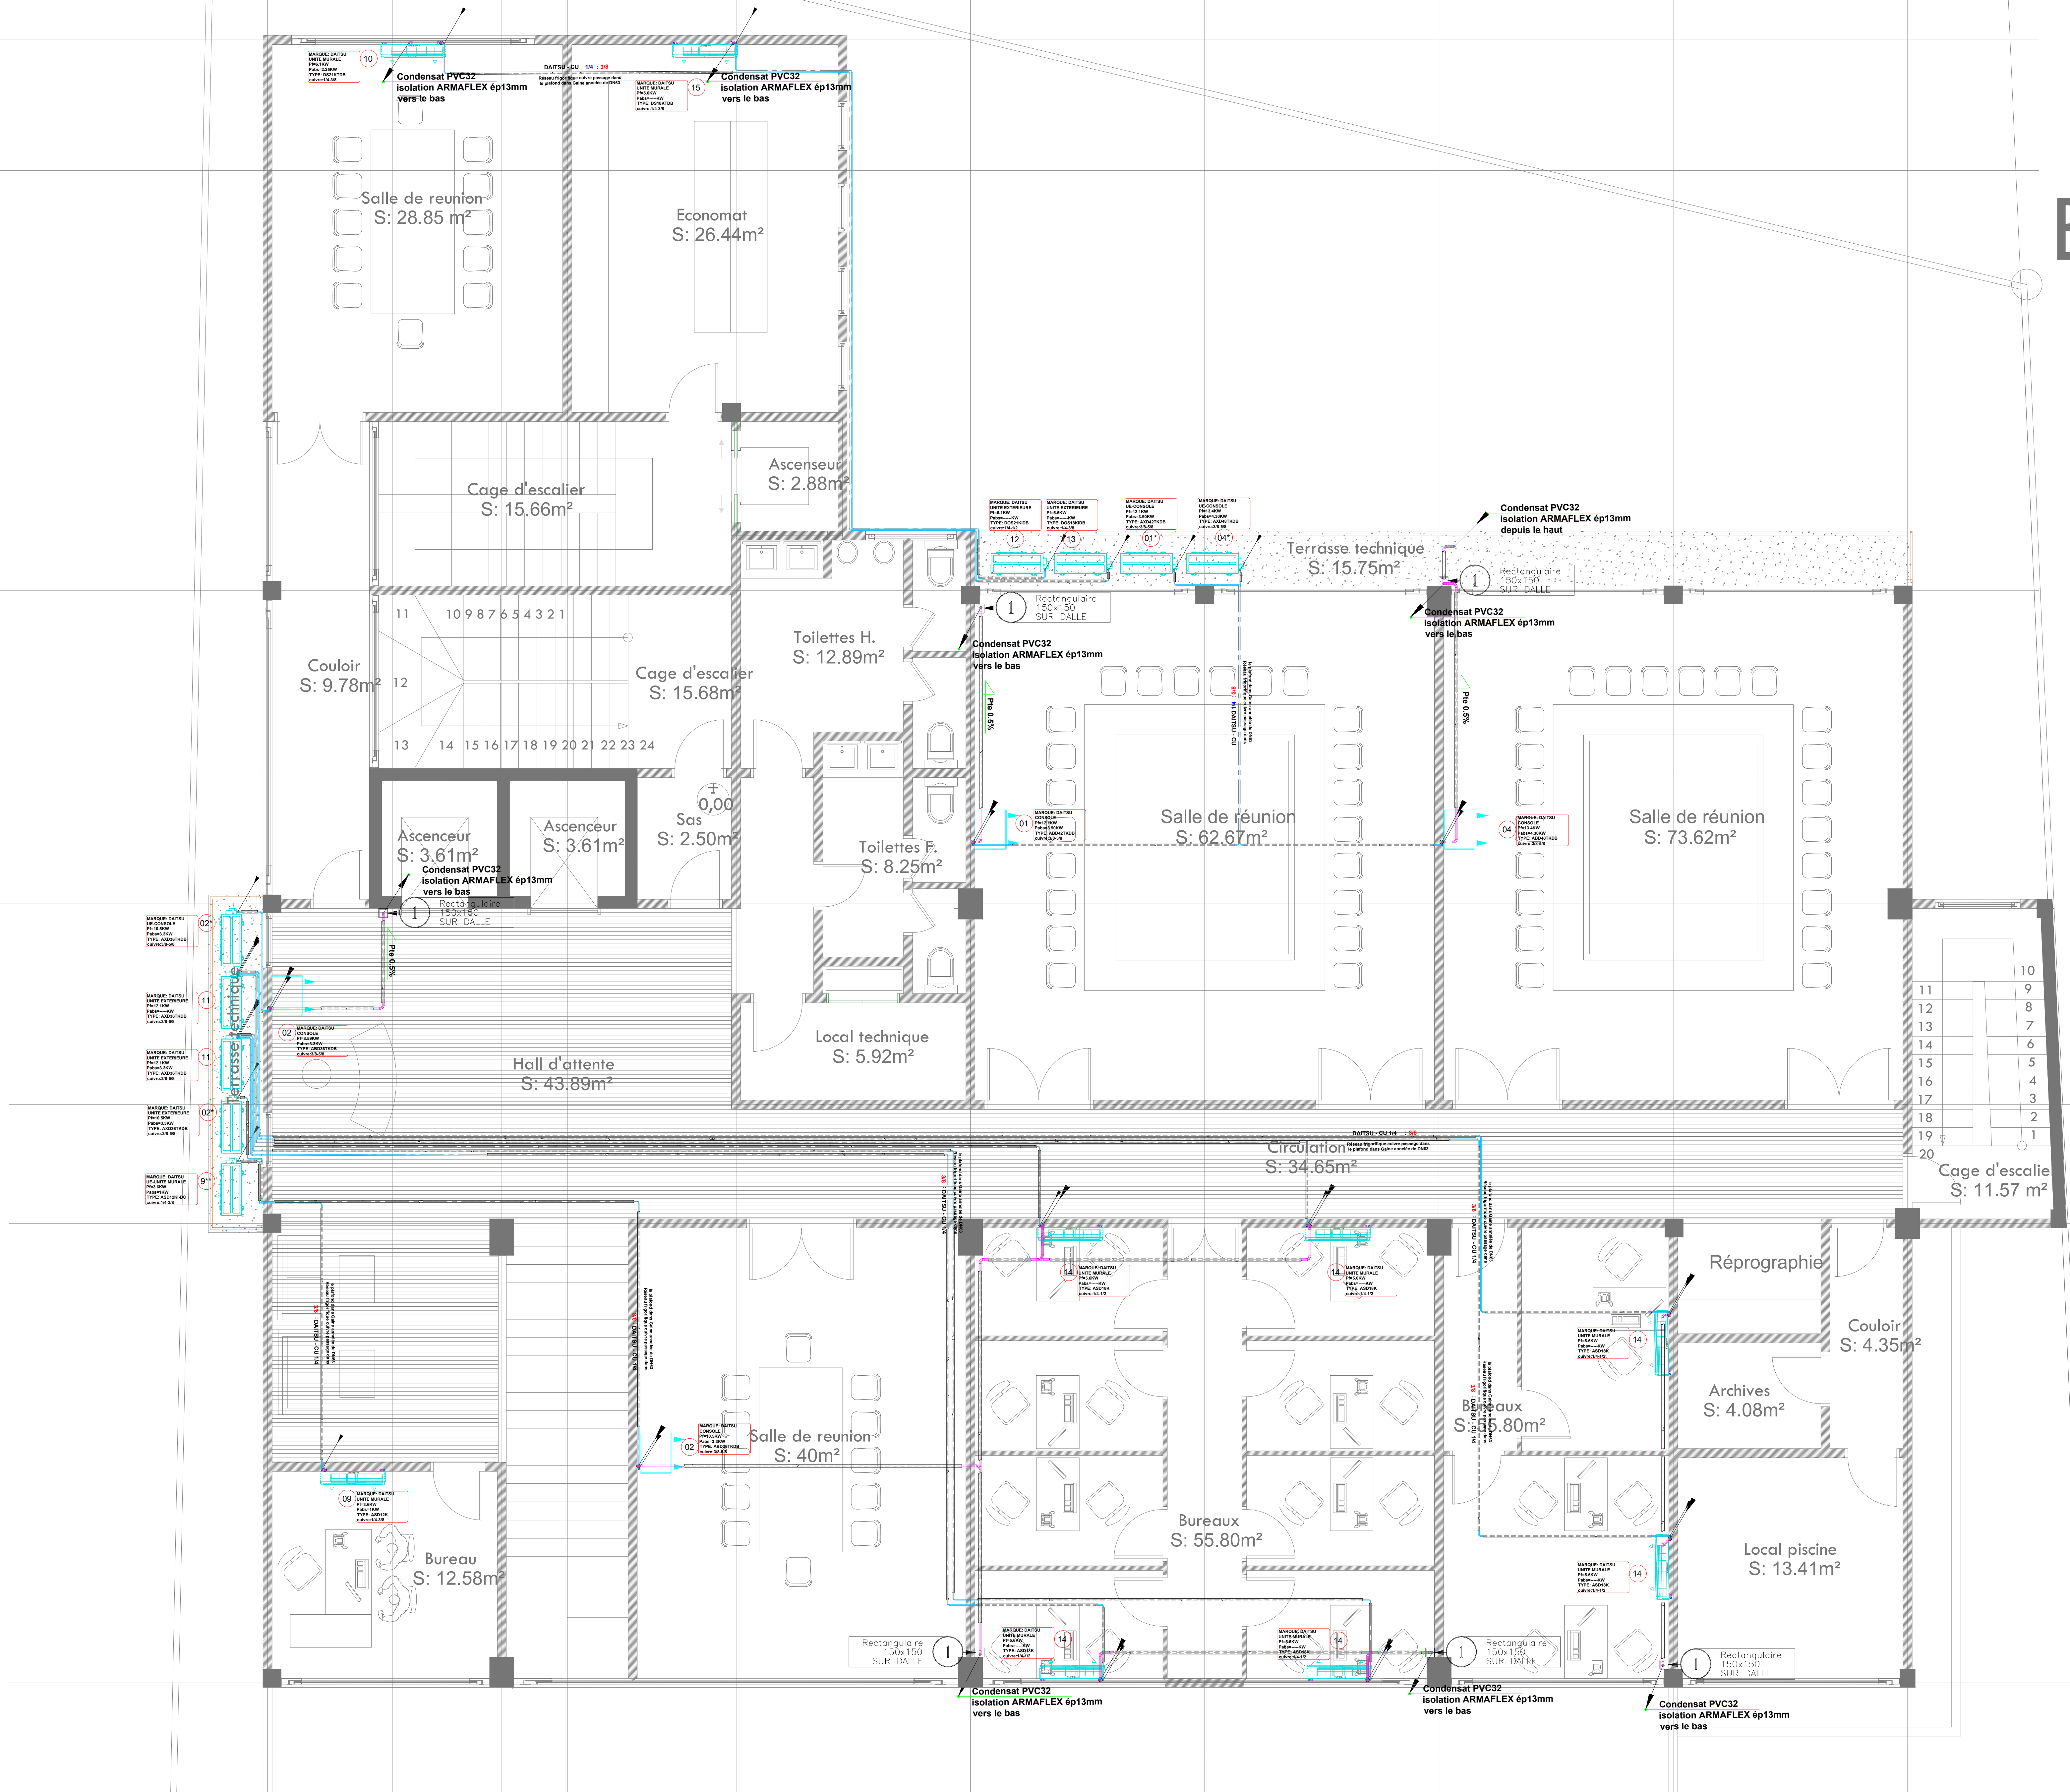

APPAREILS

Zone concernée: ETAGE 01

NUMERO	NOM	MARQUE	TYPE	SECTION	DEBIT	NOM/RESEAU	QW
01	CONSOLE	DATSU	ASD4TKDB	42	-	PF12.1KW- PABS 3.9KW	1
02	CONSOLE	DATSU	ASD3TKDB	36	-	PF10.9KW- PABS 3.9KW	2
04	CONSOLE	DATSU	ASD4TKDB	48	-	PF13.4KW- PABS 4.3KW	1
08	UNITE MURALE	DATSU	ASD1TK	12	-	PF5.6KW- PABS 1KW	1
01*	UNITE EXTERIEURE CONSOLE	DATSU	AXD4TKDB	42	-	PF12.1KW- PABS 3.9KW	1
10	UNITE MURALE	DATSU	DS21TKDB	21	-	PF6.1KW- PABS 2.2KW	1
11	UNITE EXTERIEURE DE CONSOLE	DATSU	ASD2TKDB	42	-	-	2
12	UNITE EXTERIEURE DE CONSOLE	DATSU	DSB-21KDB	21	-	-	1
13	UNITE MURALE	DATSU	DSB-19KDB	18	-	-	1
14	UNITE MURALE	DATSU	ASD1TK	18	-	PF5.6KW- PABS 1.5KW	6
15	UNITE MURALE	DATSU	DS18TKDB	18	-	PF5.6KW- PABS 1KW	1
02*	UNITE EXTERIEURE DE CONSOLE	DATSU	AXD3TKDB	36	-	PF10.9KW- PABS 3.9KW	2
04*	UNITE EXTERIEURE DE CONSOLE	DATSU	ASD4TKDB	48	-	PF13.4KW- PABS 3.9KW	1
07*	UNITE EXTERIEURE	DATSU	ASD12KDC	12	-	PF3.9KW- PABS 1KW	1

REPUBLIQUE DU CAMEROUN
Paix-Travail-Patrie

REPUBLIC OF CAMEROON
Peace-Work-Fatherland

.....LITTORAL REGION / CITY OF DOUALA.....

PROJET : Bastos Appart Hotel

MCI

REP: _____
 SS: _____
 Tel: _____
 Mail: _____

REP: _____
 SS: _____
 Tel: _____
 Mail: _____

REP: _____
 SS: _____
 Tel: _____
 Mail: _____

PLAN DE CLIMATISATION ET EVACUATION DES CONDENSATS DE L'ETAGE 01

MCI

EXE

BASTOS-MCI-EXE-CU-COND-ET-01

Date : 05/12/2022 Format: A0-H 1189x841 Scale : 1/40

Ind.	Date	Modifications-Comments	Drawing
✓	05/12/2022	2 Edition originale MCI	TCHOUANKAM
✓			Verified
✓			TIAKO
✓			Approved
✓			NGASSA

Transmission date: The .../.../20...

Transmission date: The .../.../20...

Transmission date: The .../.../20...

Transmission date: The .../.../20...

A0-H : 1/40