


PLAN DE CLIMATISATION ET EVACUATION DES CONDENSATS DE L'ETAGE 03

B3

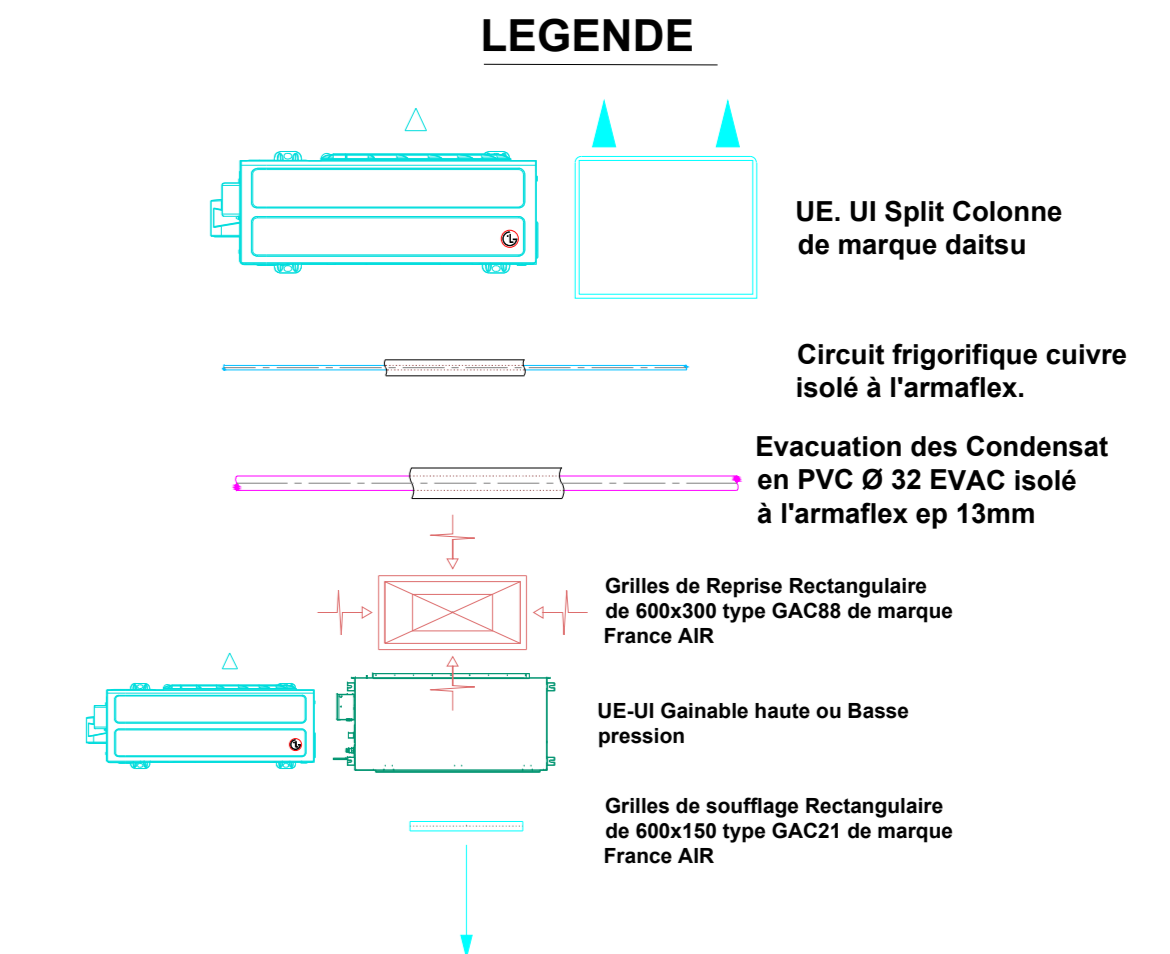

APPAREILS

Zone concernée : ETAGE 03

NUMERO	NOM	MARQUE	TYPE	SECTION	DEBIT	NOMREBEAU	Q16
02	CONSOLE	DAITSU	AD034TKDB	36	-	PF3.9KW- PABS 3.9KW	1
04	UNITE GAINABLE	DAITSU	DCFBP19K	12	700	PF1.9KW- PABS -KW	10
06	UNITE GAINABLE	DAITSU	DCFBP9K	9	500	PF2.9KW- PABS -KW	1
07	UNITE GAINABLE	DAITSU	DCFBP18K	18	800	PF4.2KW- PABS -KW	1
08	GRILLE DE SOUFFLAGE INTERIEURE	FRANCE AIR	GAC 21		600X150	-	VENT
09	UNITE EXTERIEURE DE CONSOLE	DAITSU	AD034TKDB	36	-	PF3.9KW- PABS 3.9KW	1
04	UNITE EXTERIEURE GAINABLE	DAITSU	AD420DB	42	-	PF12KW- PABS 4.9KW	3
04	GRILLE DE REPRISE EN VRAC	FRANCE AIR	GAC 38		600X300	-	VENT

REPUBLIQUE DU CAMEROUN
Paix - Travail - Patrie

REPUBLIC OF CAMEROON
Peace-Work-Fatherland

.....LITTORAL REGION / CITY OF DOUALA.....

PROJET : Bastos Appart Hotel

MARQUE	BUREAU	PROJET
DAITSU	BASTOS-MCI-EXE-CU-COND-ET-03	05/12/2022
REP: MCI	REP: MCI	REP: MCI
SS: MCI	SS: MCI	SS: MCI
Tel: MCI	Tel: MCI	Tel: MCI
Mail: MCI	Mail: MCI	Mail: MCI

PLAN DE CLIMATISATION ET EVACUATION DES CONDENSATS DE L'ETAGE 03

MCI EXE BASTOS-MCI-EXE-CU-COND-ET-03

Date : 05/12/2022 Format: A0-H 1189x841 Scale :1/40

Incl	Date	Modifications-Comments	Drawing
✓	05/12/2022	Edition originale MCI	TCHOUANKAM
✓			Verified
✓			TIAKO
✓			Approved
✓			NGASSA

VISA PRENEUR	VISA EQUIPE PROJET	VISA INGENIEUR MARCHE	VISA CHEF SERVICE MARCHE
Transmission date: / / 20	Transmission date: / / 20	Transmission date: / / 20	Transmission date: / / 20

A0-H :1/40